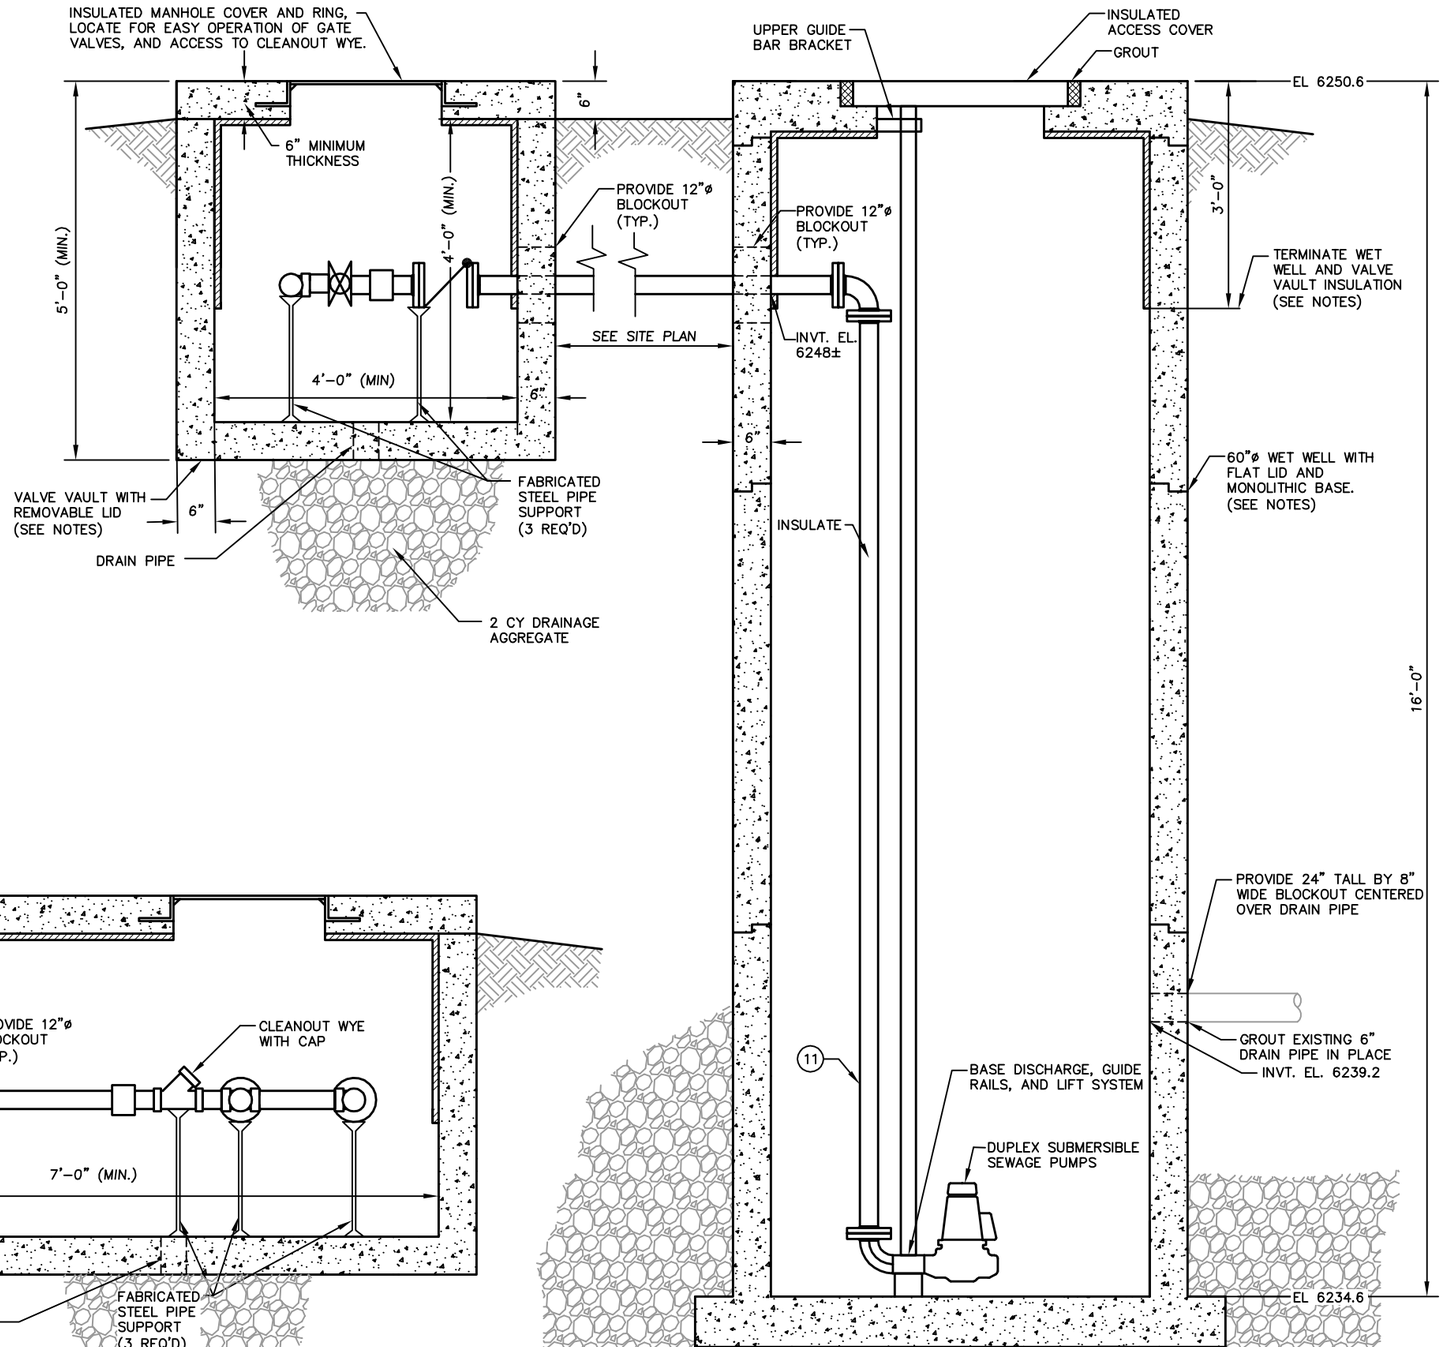

SECTION A–A

NOT TO SCALE

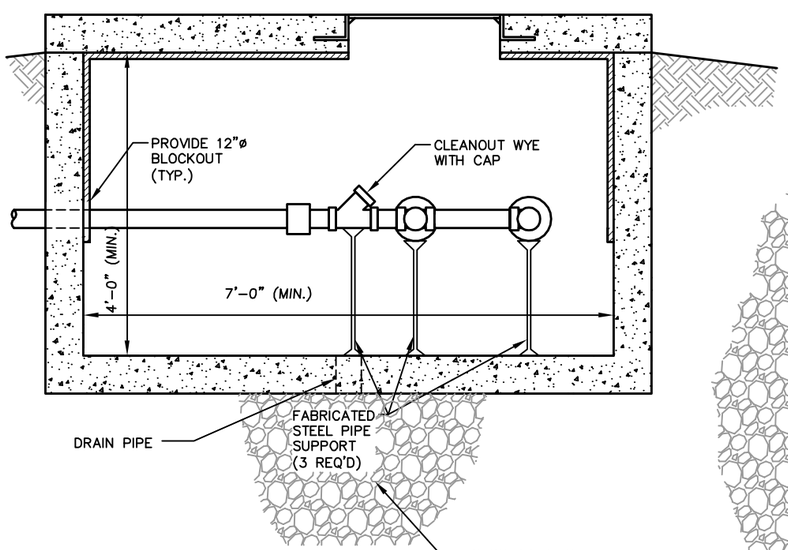

SECTION B–B

NOT TO SCALE

NOTE:

SEE SPECIAL NOTES ON SHEET 2 REGARDING LAYOUT OF PROJECT COMPONENTS.

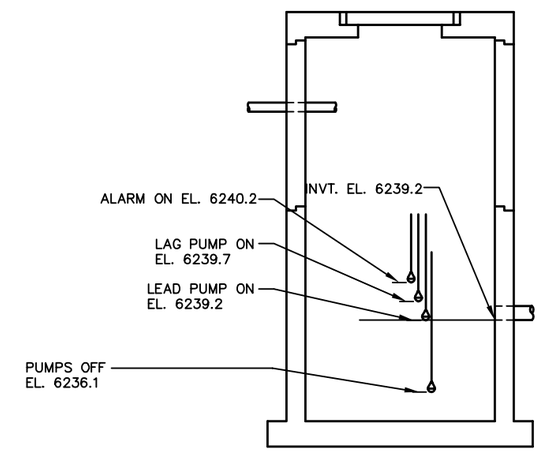

FLOAT SWITCH SETTING SCHEMATIC

NOT TO SCALE

INSULATION NOTES:

1. INSULATE WET WELL DISCHARGE PIPE. ALL VALVE VAULT PIPING AND VALVES WITH 1" OF JACKETED FIBERGLASS INSULATION, OWENS/CORNING ASJ/SSL–II OR EQUAL.
2. INSULATE LID AND WALLS OF WET WELL AND VALVE VAULT WITH 2" RIDGID POLYURETHANE. ATTACH WITH WATER PROOF MASTIC.

NO.	REVISIONS	DATE

WWC ENGINEERING

WET WELL AND VALVE VAULT
SHEET 2 OF 2

NORTH FRONT STREET DRAIN IMPROVEMENTS
CITY OF ROCK SPRINGS, WYOMING

DESIGNED BY: DEM
DRAWN BY: DEM
CHECKED BY: MTS
DATE: 11/07

DRAWING
D2

SHEET
6 OF 11